

District Manager's Report

March 28, 2019

Last Month's Follow up

P.A.S. project phase 2 fences and sod have been replaced. The system is open for service and functional.

Pump Station

Routine operations at all stations.

Canals

This Month = 4.33'

Previous Month = 4.49'

Year to Date = 4.37'

Rainfall

This Month = 2"

Previous Month total = 3.5"

Year to date = 10"

Projects

P.A.S. project phase 2 has been restored and is functional.

Phase 3 is in restoration.


Phase 4 has commenced.

Fleet

Oil changes for all vehicles.

Safety

No incidents to report at this time.

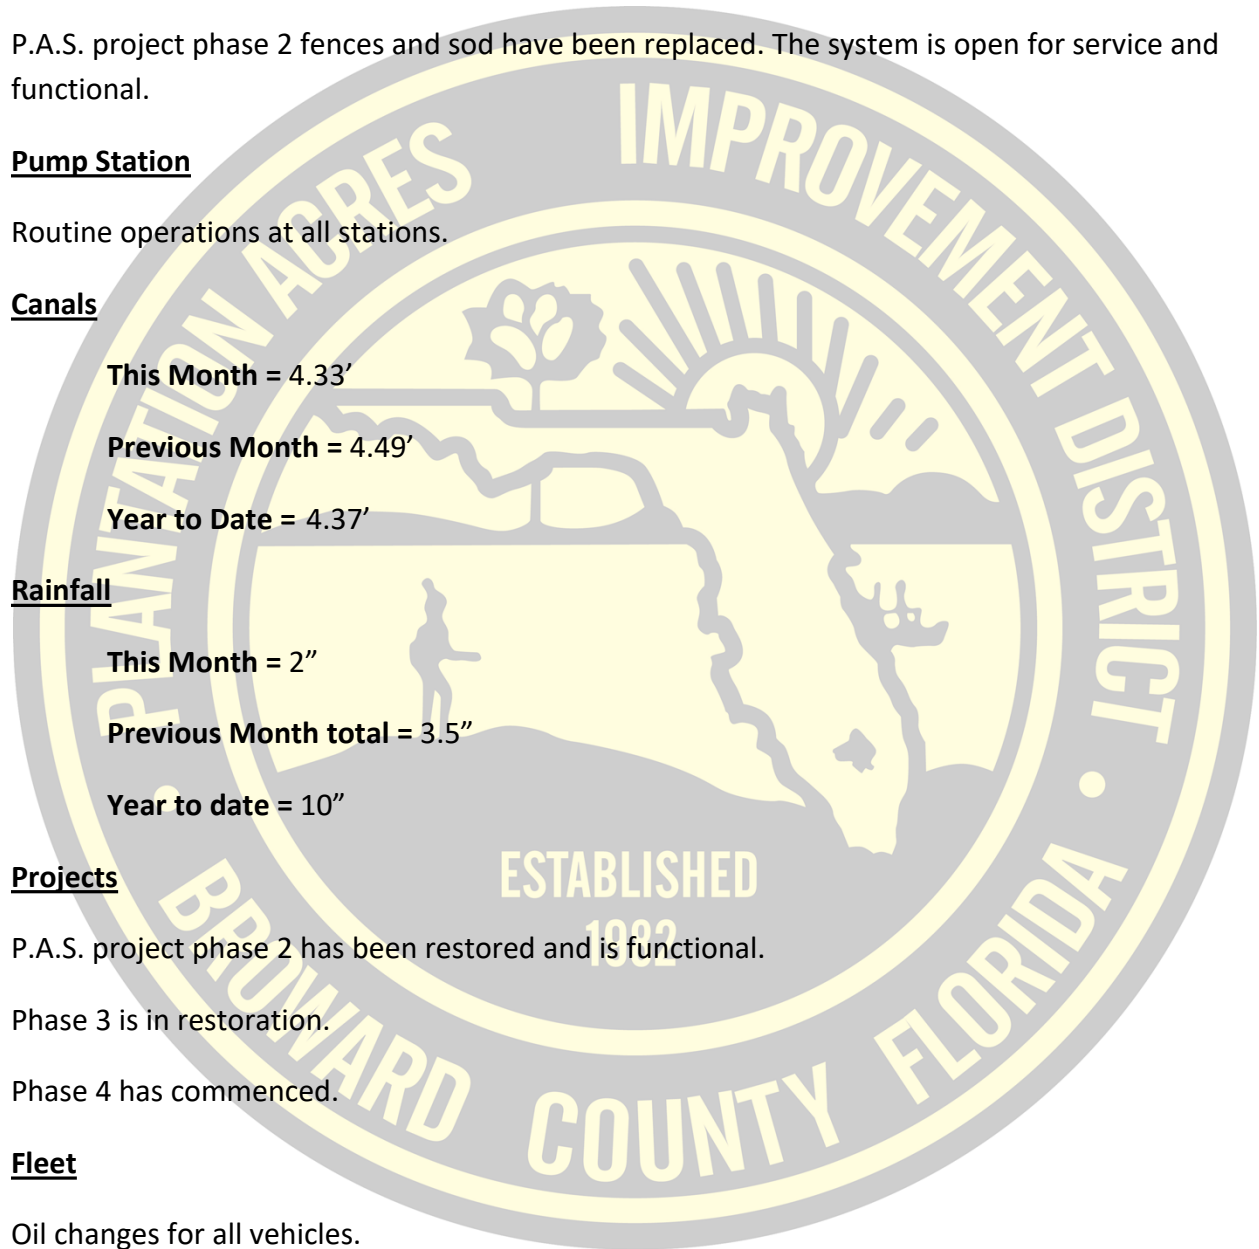

New

Annual fire extinguisher inspection/service completed.

Annual fire safety inspection scheduled for April 2019.

Generator service tech scheduled for 3-26-19 for estimate on repair/replacement.

Angel Alvarez
District Manager

